





Capacity	[ KW ]	3.25	Minimum Number Of Motor		1
Inlet Air Temperature	[°C]	-23.00	Evaporating temperature [Mid]	[ °C ]	-30.00
DT [Dew]	[K]	4.75	Refrigerant		R449A
Minimum number of units in room		0	Altitude	[ m ]	0.0
Heat exchanger	Aluminium fin		Casing	Standard	
Fan motor feed	Standard		Type of fan motor	AC motors	
Defrost	Electric				
Selected model:1 x GCE 352E8		E	D		
Capacity	[ kW ]	3.91	Margin	[%]	20.2
DT [Dew]	[K]	4.1	Tot. air flow	[ m³/h ]	5280.0
Tot. Pres.S.Lev.	[dB(A) @[m]]	53 (5m)			

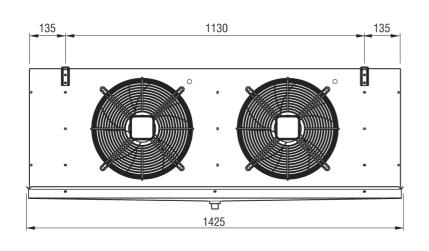

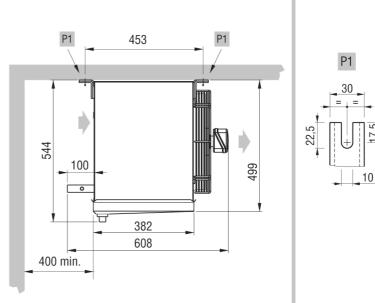

Weight	kg	39.500	PED Category		Cat I
			Design Pressure PS	[bar]	30
Internal surface	m²	2.38	External surface	m²	16.60
Inlet connection		16 mm	Output connection		28 mm
Total circuit capacity	dm³	3.5	Fin spacing	mm	8
Drain connection		1" GAS			
Defrost	ED		Electric	W	3150
Fan Motors	n.	2	Diameter	mm	350
Air flow	m³/h	5280	Air throw	m	16.0
Feed	V	230/1/50-60	Rotation speed	rpm	1450
Fan Motor	А	1.92	Absorbed power	W	370
Pres.S.Lev. 5 m.	dB(A)	53			



\* The safety requirements for the use of refrigerants must comply with the provisions of the EN378 standards and the safety data sheets of each fluid used. The risk assessment for the use of A2L mid-flammable refrigerants shall be conducted by the user based on site requirements

We shall not be liable for the performance and the quality of sold products, if fitted or connected fan motor speed regulation or control systems are different from the ones proposed or installed by us.





Unit Cooler 21/11/2024

ED	
Heat exchanger	
Aluminium fin	EUR 0.00
Casing	
Standard	EUR 0.00
Fan motor feed	
Standard	EUR 0.00
Type of fan motor	
AC motors	EUR 0.00
Defrost	
ED - Electric	EUR 0.00
Base Price	EUR 2,156.00
Surcharge Water Version	EUR 0.00
Total Options	EUR 0.00
Total Price	EUR 2,156.00



\* The safety requirements for the use of refrigerants must comply with the provisions of the EN378 standards and the safety data sheets of each fluid used. The risk assessment for the use of A2L mid-flammable refrigerants shall be conducted by the user based on site requirements